

# BYDA Drawing Template

## Requirements and Examples



Powering a  
Bright Future

The purpose of this drawing / template is to clearly identify the location of the Private Underground Consumer Mains (PUCM) between TasNetworks assets and the private property boundary, enabling TasNetworks to register this section of PUCM with 'Before You Dig Australia' (BYDA).

*\* Private underground mains inside the private property boundary are not recorded in BYDA by TasNetworks.*

The form must be completed by the **Electrical Practitioner** performing the works onsite and be submitted with the **EWR** as part of the conditional approval requirements for the application. Failure to provide this form will result in the EWR being returned, which will delay the connection process.

### **Form Requirements:**

- Only the official **TasNetworks BYDA form** is to be used — *alternative templates will not be accepted.*
- All fields must be completed **clearly and legibly** – including name, date and signature.
- Submissions may be **handwritten, computer-generated, or include a photograph**, provided all information is legible.
- **The drawing must clearly show:**
  - The **location and measurements** of the Private Underground Consumer Mains (PUCM) as installed up to the customer boundary (*as per the examples below*).
  - The location of the **TasNetworks asset**

**Note:** Incomplete or illegible drawings will be returned to the originator for correction and resubmission.

*This form does not guarantee council approval for the proposed connection type or its suitability in all scenarios. Approval remains at the discretion of the relevant authority and is required to be submitted as part of the connection application process.*

---

For further information contact **TasNetworks Service Centre 1300 137 008** and follow the prompts

---

***Drawing examples are on following pages***

# BYDA Drawing Template

## Requirements and Examples




Powering a  
Bright Future

This form must be completed by the Electrical Professional performing the work.

Electrician		CEC	
Company		Address of Installation	
Licence No.		Date of Installation	
Contact Number		TasNetworks Asset No.	

*\*Dimensions (DIM) to be given in metres to two decimal places (ie 1.52m)*

*\*Private underground mains inside the private property boundary are not recorded in BYDA by TasNetworks*

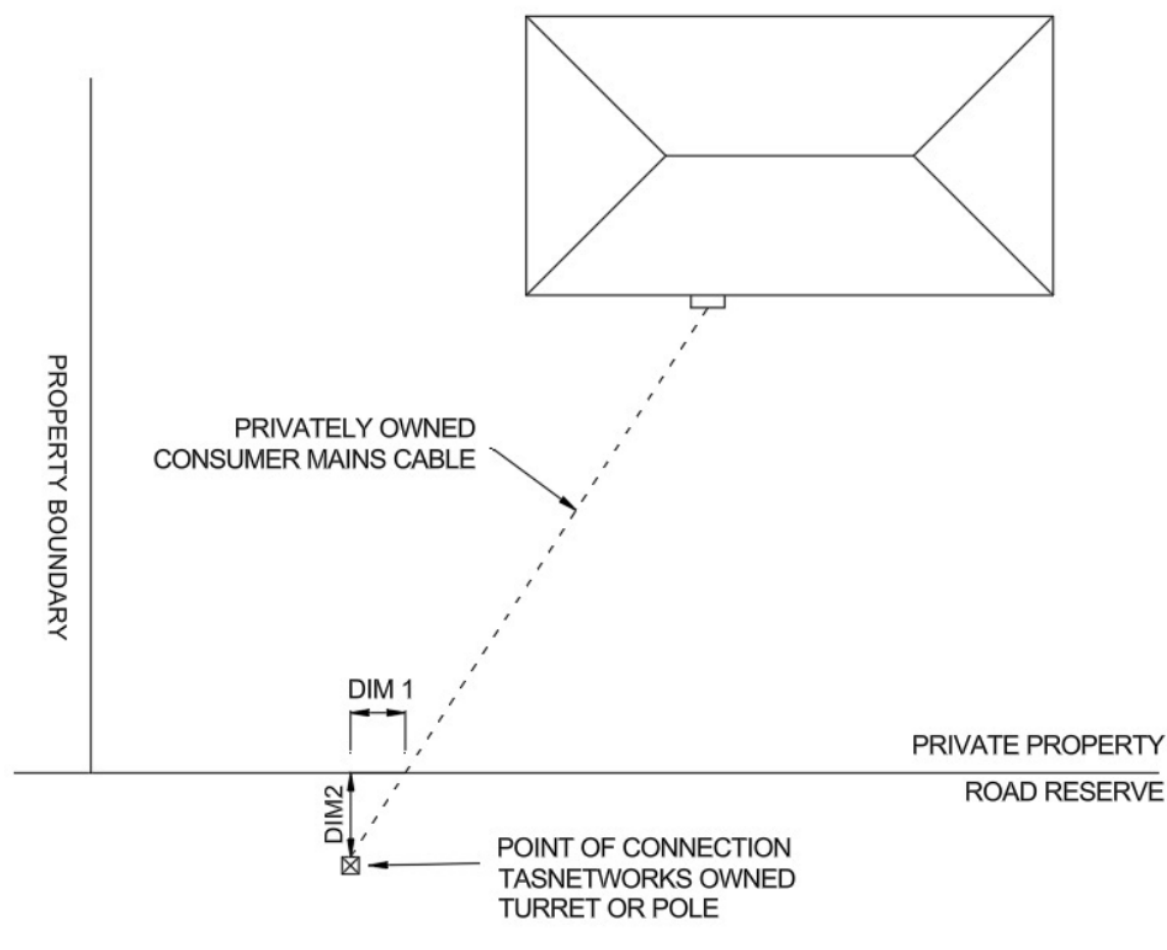

*I acknowledge that the information provided herein is accurate.*

Name		Date	
Signature			

# BYDA Drawing Template

## Requirements and Examples




Powering a  
Bright Future

This form must be completed by the Electrical Professional performing the work.

Electrician		CEC	
Company		Address of Installation	
Licence No.		Date of Installation	
Contact Number		TasNetworks Asset No.	

*\*Dimensions (DIM) to be given in metres to two decimal places (ie 1.52m)*

*\*Private underground mains inside the private property boundary are not recorded in BYDA by TasNetworks*

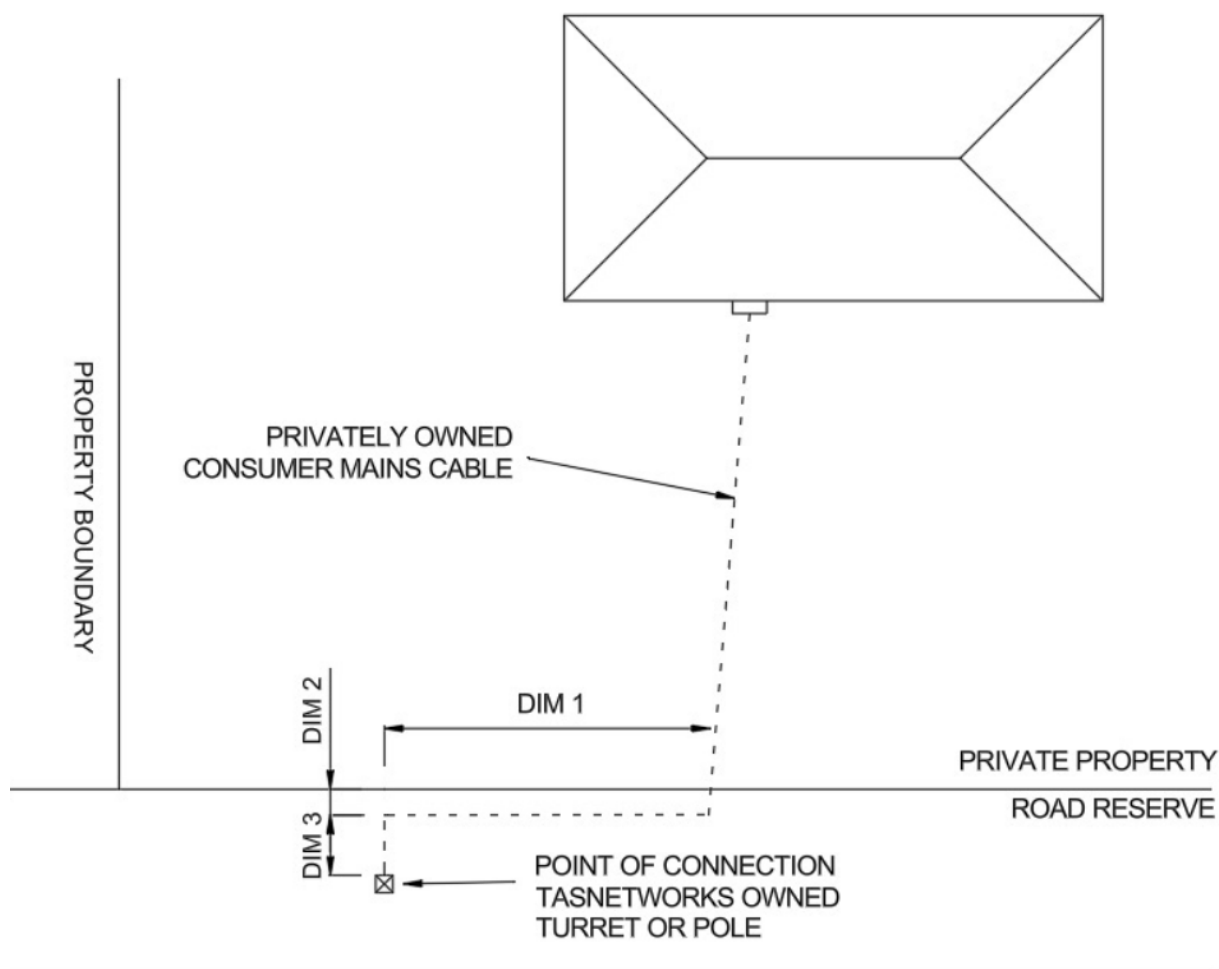

*I acknowledge that the information provided herein is accurate.*

Name		Date	
Signature			