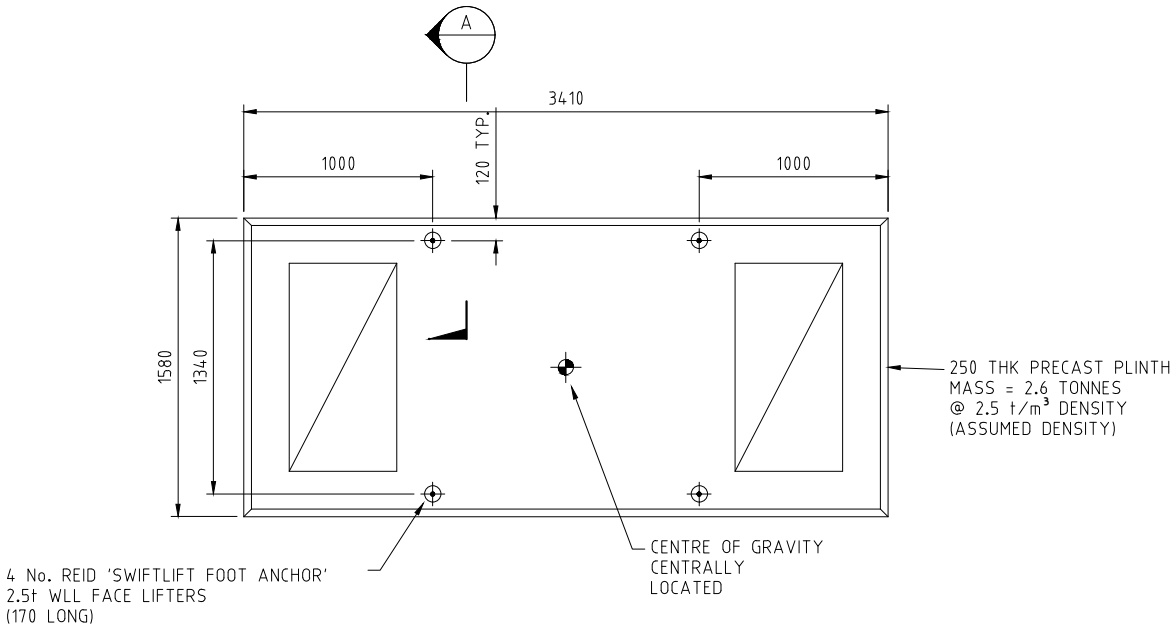

PRECAST PLINTH LIFTING PLAN

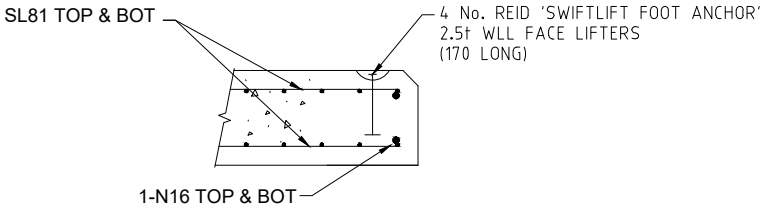

SECTION A
SCALE 1:20

ONLY OUTER BARS BESIDE LIFTER ARE SHOWN

NOTES
1. CONCRETE SHALL HAVE AN EQUIVALENT STRENGTH TO $f'c$ = 25MPa AT TIME OF LIFT.
2. THE LIFTING DESIGN ASSUMES THE FOLLOWING:
   - 2.1 THAT THE PLINTH IS POURED ONTO AN OILED STEEL FORMWORK SURFACE.
   - 2.2 THAT SIDE FORMWORK IS REMOVED PRIOR TO LIFTING OFF THE FORMWORK BED.
   - 2.3 DEMOULDING OFF THE BED IS UNDERTAKEN CAREFULLY AND WITHOUT SHOCK LOADING.
   - 2.4 SLINGS SHALL BE ATTACHED TO A CERTIFIED SPREADER BEAM SO THAT THE LIFTED LOAD IS SUPPORTED EQUALLY BY FOUR SLINGS.
   - 2.5 SLINGS SHALL BE ARRANGED SO THAT THE INCLUDED ANGLE IS ≤ 60°.
   - 2.6 THAT THE PLINTH IS LIFTED BY A STATIONARY HYDRAULIC CRANE, AT NORMAL CRANE HOIST SPEED.
3. DESIGN AND VERIFICATION OF THE SLINGS, SPREADER BEAM AND CRANE IS THE RESPONSIBILITY OF THE CONTRACTOR AND HIS SPECIALIST RIGGERS.
4. FOR PRECAST PLINTH REINFORCEMENT DETAILS REFER KS-303.
5. ONLY APPROVED, TAGGED AND TESTED MANUFACTURER'S LIFTING CLUTCHES SHALL BE USED FOR LIFTING.

DIMENSIONS ARE IN MILLIMETRES
UNLESS OTHERWISE STATED

ALTERATIONS	REV	PROJECT	DESIGNED BY	ENG.CHECK	ENG.APPROV.
ORIGINAL ISSUE	B		DRAWN BY G.HALL	DATE 29/AUG/2023	DATE 29/AUG/2023
DRAWING TITLE REVISED TO INCLUDE TYREE KIOSKS.				B.NARAYANASAMY	J.HUGHES

TasNetworks

DRAWN	C5 PRO SOLUTIONS
DESIGNED BY	-
CHECKED BY	G.HALL
APPROVED BY	D.ELLIS
DATE APPROVED	05/02/2016

© Tasmanian Networks PTY. LTD.
trading as TasNetworks
ABN: 24 167 357 299

NO PART OF THIS DRAWING MAY BE REPRODUCED, STORED IN A RETRIEVAL SYSTEM IN ANY FORM, OR TRANSMITTED BY ANY MEANS WITHOUT THE PRIOR PERMISSION OF TASNETWORKS

TITLE
KIOSK SUBSTATION
PLINTH LIFTING DETAILS
TYREE 750/1000 kVA AND SCHNEIDER 3/10 KIOSKS

SCALE NTS

A4

KS-322

REVISION B