



SITE PLAN
SCALE 1:250

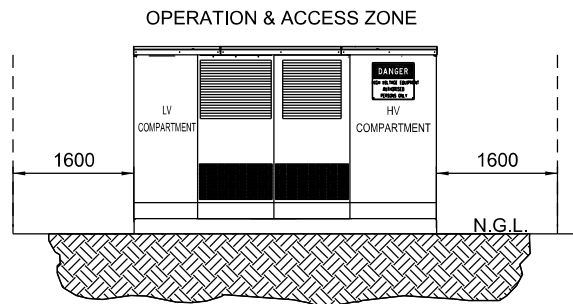

SECTION A-A
SCALE 1:100

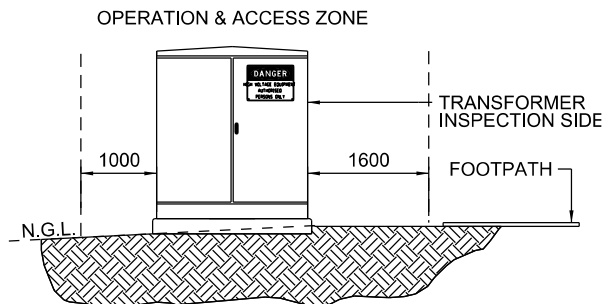

SECTION B-B
SCALE 1:100

LEGEND:
[Hatched Box] OPERATION & ACCESS ZONE

- NOTES:
- CARE SHOULD BE TAKEN NOT TO DAMAGE THE EXISTING STRUCTURES DURING INSTALLATION.
 - SURROUND TO BE GRADED TO CONCRETE PAD, NATURAL GROUND AND FOOTPATH AND TO ALLOW NATURAL DRAINAGE.
 - SUBSTATION LIFTING HOLES TO BE KEPT CLEAR.
 - GROUND IN VICINITY OF SUBSTATION TO BE REINSTATED AFTER CONSTRUCTION IS COMPLETED.
 - SUBSTATION BASE NOT SHOWN. REFER TO KS-317, D-KS1-0337-SD-001 & KS-318.
 - FOR PROPOSED KIOSK TYPE SUBSTATION CHOOSE STRAIGHT ROAD IF AVAILABLE.
 - VEGETATION SUCH AS TREES SHALL BE 2000 MIN FROM SUBSTATION EARTH GRID.
 - SITE LOCATION SHALL CONSIDER EARTHING REQUIREMENTS. REFER TO TASNETWORKS KIOSK DESIGN STANDARD.

EMF/PDF CREATION DATE 04/AUG/17

AL T E R A T I O N S

ORIGINAL ISSUE	
REVISED FOUNDATION REFERENCE TO INCLUDE D-KS1-0337-SD-001	
REV	B
PROJECT	C516011
DESIGNED BY	TasNetworks
C5 PRO-SOLUTIONS	PRO-SOLUTIONS
DATE	22/06/2017
ENGINEER	G.HALL
ENGINEER PROV.	G.HALL
DATE	04/AUG/17

DRAWN	SMECKS DRAFTING
DESIGNED BY	TASNETWORKS
CHECKED BY	G.HALL
APPROVED BY	D.ELLIS
DATE APPROVED	05/02/2016

© Tasmanian Networks PTY. LTD. trading as TasNetworks ABN: 24 167 357 299	
NO PART OF THIS DRAWING MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE PRIOR PERMISSION OF TASNETWORKS	
TITLE	KIOSK SUBSTATION GUIDE FOR SITE SELECTION
SCALE	AS INDICATED
REVISION	B