


Scale 1 : 25

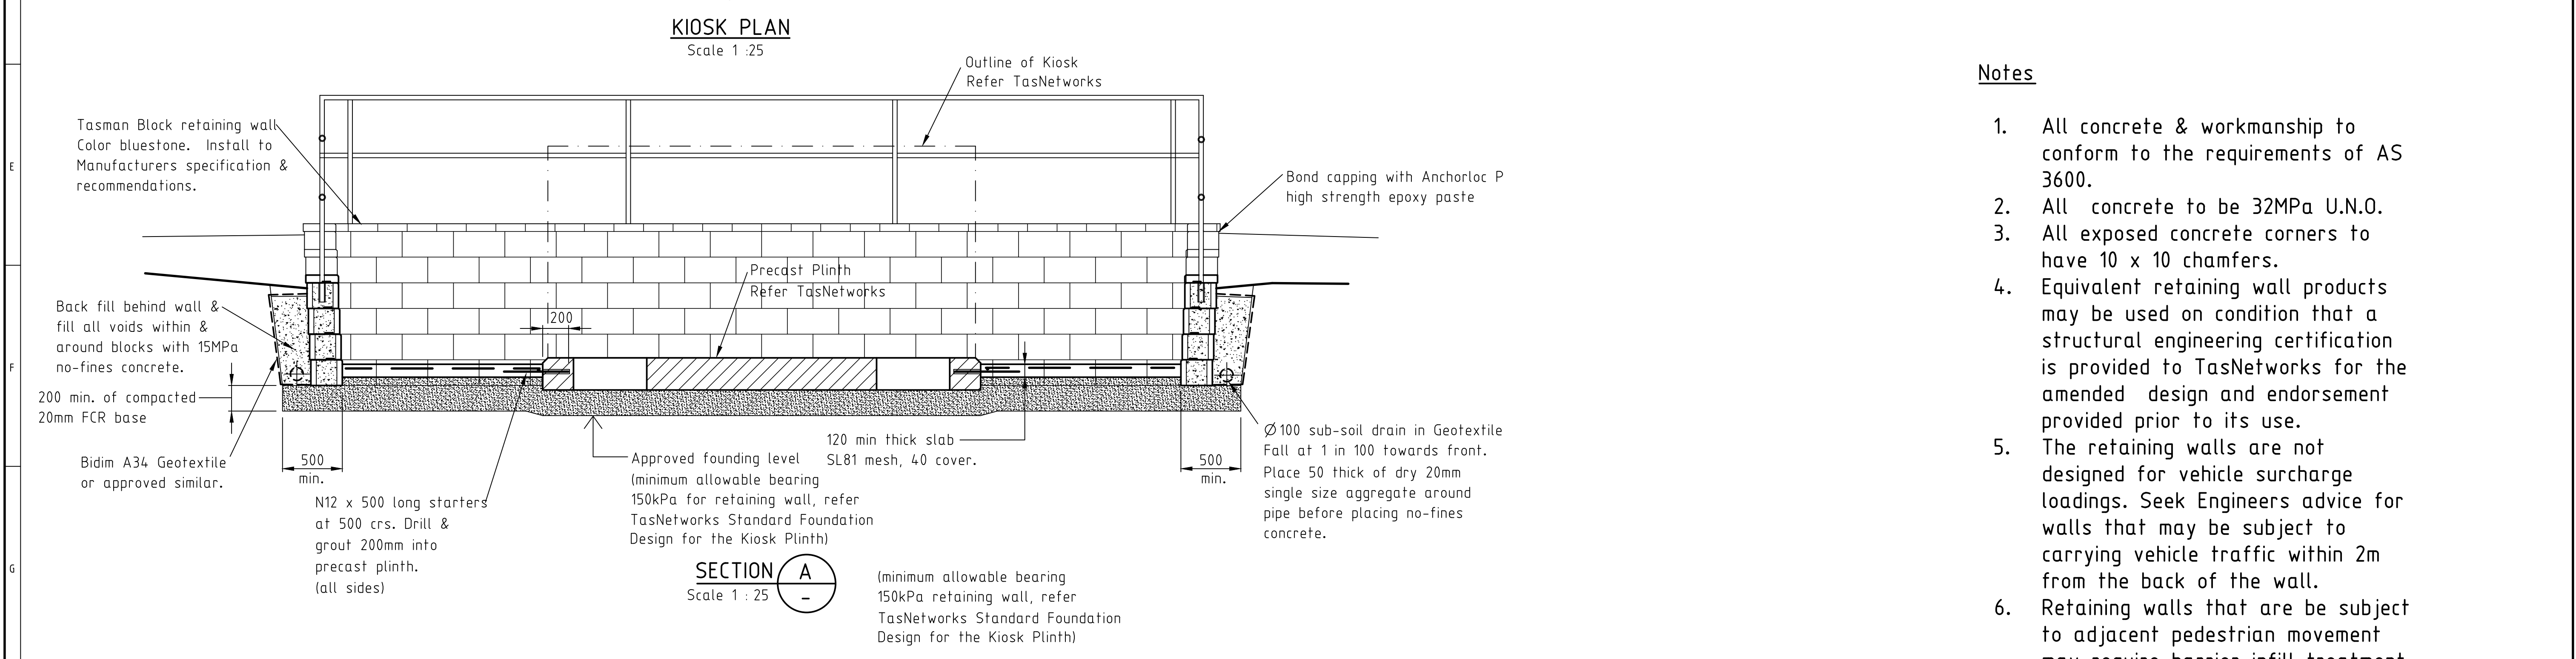


Notes

1. All concrete & workmanship to conform to the requirements of AS 3600.
2. All concrete to be 32MPa U.N.O.
3. All exposed concrete corners to have 10 x 10 chamfers.
4. Equivalent retaining wall products may be used on condition that a structural engineering certification is provided to TasNetworks for the amended design and endorsement provided prior to its use.
5. The retaining walls are not designed for vehicle surcharge loadings. Seek Engineers advice for walls that may be subject to carrying vehicle traffic within 2m from the back of the wall.
6. Retaining walls that are be subject to adjacent pedestrian movement may require barrier infill treatment.

Seek Engineers advice if required.

CONSTRUCTION SIGN OFF			
CONSTRUCTION RESPONSIBILITY	SIGNATURE	COMPANY	DATE
CIVIL AEC REPRESENTATIVE			
ELECTRICAL PLANT INSTALLER			
COMMISSIONING MANAGER			
TASNETWORKS REPRESENTATIVE			

[illegible]